


REVISIONS	
DESCRIPTION	DATE
NEW RELEASE	12/15/13
REV A -UPDATED TEXT	01/13/15
REV B -UPDATED TEXT	02/08/20

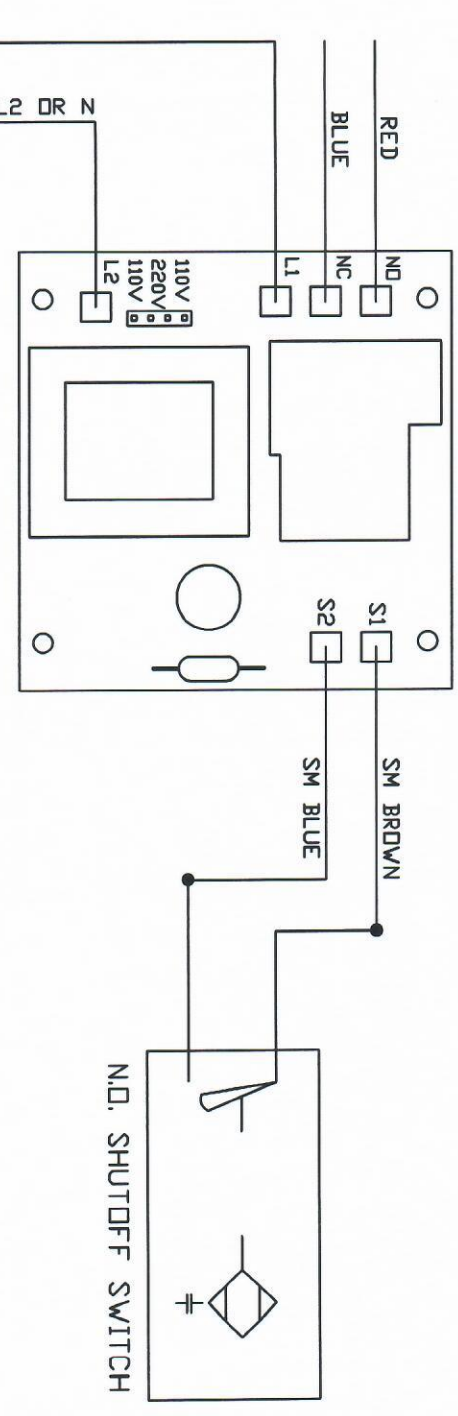

VOLTAGE SELECTION

FOR 110V - PUT JUMPERS ON THE OUTER PINS MARKED 110V (IF ONLY ONE JUMPER IS ON THE BOARD REMOVE THE JUMPER THAT IS GLUED TO THE TOP OF THE RELAY)
 FOR 220V - PUT ONE JUMPER ON THE CENTER PINS MARKED 220V

- ▲ L1-LINE #1 } 110VAC/220VAC
- ▲ L2-NEUTRAL OR LINE #2 }
- -INDICATES WIRENUT CONNECTION
- NC-NORMAL CLOSED (ON)
- ND-NORMALLY OPEN (OFF)

MOORE AUTOMATION
 MOORE AUTOMATION
 411 EAST MAIN STREET
 TRIMONT, MN 56176
 (507) 639-9031

MA1C-110V / MA1C-220V
 RELAY